Project	Project ref
Calcs for	Date

Timber Beam Design (BS 5268-2:2002)

Beam details


Beam 141 x 220 mm (3 x 47x220 mm)

C24 Grade Timber

Timber strength class C24

Service class of timber 2

Width b = 141 mmDepth h = 220 mm




Span details

Beam clear span $L_{cl} = 3.5 \text{ m}$

Bearing length $L_b = 100 \text{ mm}$

Beam effective span $L_{eff} = L_{cl} + (2 \times (L_b / 2)) = 3.6 \text{ m}$



Diagrams not to scale

Loading details



Load 1: UDL - Sloping roof, 30° to 45°

Dead load $F_{d,1} = 1.41 \text{ kN/m}^2 \times 2 \text{ m} = 2.82 \text{ kN/m}$

Imposed load $F_{i,1} = 0.75 \text{ kN/m}^2 \times 2 \text{ m} = 1.5 \text{ kN/m}$

K₄ = **1.00**

Reactions (unfactored)

	Dead	Imposed	Total
Left reaction	5.31 kN	2.70 kN	8.01 kN
Right reaction	5.31 kN	2.70 kN	8.01 kN

Modification factors

Bearing modification factor

Timber service class modification factor K2 as table 16

Bending parallel to grain $K_{2,ben} = \textbf{1.00}$ Compression perpendicular to grain $K_{2,per} = \textbf{1.00}$ Shear parallel to grain $K_{2,shr} = \textbf{1.00}$ Mean & min modulus of elasticity $K_{2,mod} = \textbf{1.00}$

Load duration factor $K_3 = 1.25$

Depth factor (BS5268-2 clause 2.10.6) $K_7 = (300 / h)^{0.11} = 1.03$

Load sharing modification factor (BS5268-2 clause 2.10.11) $K_8 = 1.10$ Modulus of elasticity modification factor (BS5268-2 clause $K_9 = 1.21$

2.9)

^{*} You can add your own text, diagrams and photos here *

Project	Project ref
Calcs for	Date

Modulus of elasticity

Timber minimum modulus of elasticity

The minimum modulus of elasticity modified by the factor K9 should be used for deflections

$$E_{min} = 7,200 \text{ N/mm}^2$$

$$E = E_{min} \times K_{2,mod} \times K_9 = 8,710 \text{ N/mm}^2$$

Section properties

Area of section Area = $b \times h = 31,000 \text{ mm}^2$

Inertia of timber about xx axis $I_w = b \times h^3 / 12 = 125,000,000 \text{ mm}^4$

Z to top edge of timber $Z = b \times h^2 / 6 = 1,140,000 \text{ mm}^3$

Average density for C24 grade timber (BS 5268-2:2002 $\rho_{mean} = 420 \text{ kg/m}^3$

Table 8)

Self weight (g = 9.81 m/s²) $F_{self} = b \times h \times L_{eff} \times \rho_{mean} \times g = 460 \text{ N}$

Section design parameters

Design bending moment M_b = **7,210,000** Nmm

Design shear force $F_{ve} = 8,010 \text{ N}$

Check bending stress



Bending moments (kNm)

Timber grade bending stress parallel to grain (BS5268-2 Table 8)

Permissible timber bending stress (factored)

Maximum bending moment

Applied bending stress in timber

$$\sigma_{t,m,g,par} = 7.5 \text{ N/mm}^2$$

$$\sigma_{t,m,adm} = \sigma_{t,m,g,par} \times K_{2,ben} \times K_3 \times K_7 \times K_8 = 10.7 \text{ N/mm}^2$$


M = **7.21** kNm

 $\sigma_{t,m,max} = M / Z = 6.34 N/mm^2$

Pass $\sigma_{t,m,max} \ll \sigma_{t,m,adm}$ (6.335 N/mm² \ll 10.67 N/mm²) applied bending stress in timber within permissible

Project	Project ref
Calcs for	Date

Check deflection (including shear deflection as required by clause 2.10.7)

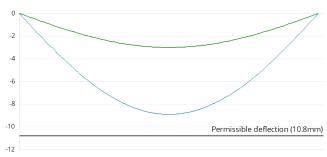

Live load deflection (green) and total load deflection (blue) in mm

Deflection based on E = 8712 N/mm²

Dead load deflection without shear

Imposed load deflection without shear

Total dead & imposed load deflection

Modulus of rigidity

Shape factor for rectangular section

Shear area for beam

Total dead & imposed load

If total dead & imposed load applied as a UDL, additional

deflection due to shear

Shear deflection

Permissible deflection

Total deflection inclusive of shear

 δ_d = **5.91** mm

 $\delta_1 =$ **3.01** $\, \text{mm}$

 $\delta_{t} = 8.92 \text{ mm}$

 $G = E / 16 = 544 \text{ N/mm}^2$

K_F = 1.2

 $A_v = EA / K_F = 25,800 \text{ mm}^2$

WT = 16 kN

 $\delta_{su} = WT \times L_{eff} \times 10^6 / (8 \times A_v \times G) =$ **0.512** mm

 δ_{shear} = δ_{su} × M / (WT × L_{eff} / 8) = **0.512** mm


 $\delta_{adm} = 0.003 \times L_{eff} \times 10^3 =$ **10.8** mm

 $\delta_{\text{max}} = \delta_{\text{d}} + \delta_{\text{i}} + \delta_{\text{shear}} =$ **9.44** mm

Pass $\delta_{max} \ll \delta_{adm}$ (9.44 mm \ll 10.8 mm), therefore OK for deflection

Project	Project ref
Calcs for	Date

Check shear stress

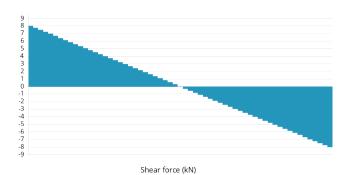

No notches to occur at the critical shear position.

Timber grade shear stress parallel to grain (BS5268-2 Table 8)

Permissible shear parallel to grain (factored)

Permissible shear force on timber

Design shear force

 $\tau_{t,g,par} = 0.71 \text{ N/mm}^2$

 $\tau_{t,adm} = \tau_{t,g,par} \times K_{2,shr} \times K_3 \times K_8 = \textbf{0.976} \text{ N/mm}^2$

 $F_{t,adm} = 2 \times \tau_{t,adm} \times b \times h / 3 = 20,200 N$

 $F_{ve} = 8,010 \text{ N}$

Pass $F_{ve} \leftarrow F_{t,adm}$ (8006 N \leftarrow 20189 N) shear capacity of timber is greater than applied shear force, therefore OK

Check bearing stress

Timber grade compressive stress perpendicular to grain (BS5268-2 Table 8)

Permissible compressive stress perpendicular to grain (factored)

Timber bearing stress on support

 $\sigma_{t,c,g,\boxtimes} = 1.9 \text{ N/mm}^2$

 $\sigma_{t,c,adm} = \sigma_{t,c,g,\underline{w}} \times K_{2,per} \times K_3 \times K_4 \times K_8 = \textbf{2.61 N/mm}^2$

 $\sigma_{t.c.max} = F_{ve} / (L_b \times b) = 0.568 \text{ N/mm}^2$

Pass $\sigma_{t,c,max} \le \sigma_{t,c,adm}$ (0.568 N/mm² \le 2.613 N/mm²) bearing stress is less than permissible timber stress, therefore OK

Design summary

	Permissible	Applied/Actual	Utilisation	Result
Shear force (kN)	20.2	8.01	39.7 %	ОК
Bending stress (N/mm²)	10.7	6.34	59.4 %	ОК
Bearing stress (N/mm²)	2.61	0.57	21.7 %	ОК
Deflection (mm)	10.8	9.44	87.4 %	ОК

Notes

Joists to be bolted together with M12 bolts at 600mm spacings.

Project	Project ref
Calcs for	Date

This design is in accordance with BS 5268-2:2002 Structural use of timber - Part 2: Code of practice for permissible stress design, materials and workmanship.

The depth to width ratio of the timber does not exceed 5 and as per the requirements of BS 5268-2 Table 19 there is no risk of buckling under design load provided; The ends are held in position and compression edge held in line, as by direct connection of sheathing, deck or joists.

Timber to be covered, this calculation is not to be used for timber which is fully exposed to the elements.

Wane as allowed in BS 4978:2007 + A2:2017 is permitted.